



PLAN VIEW

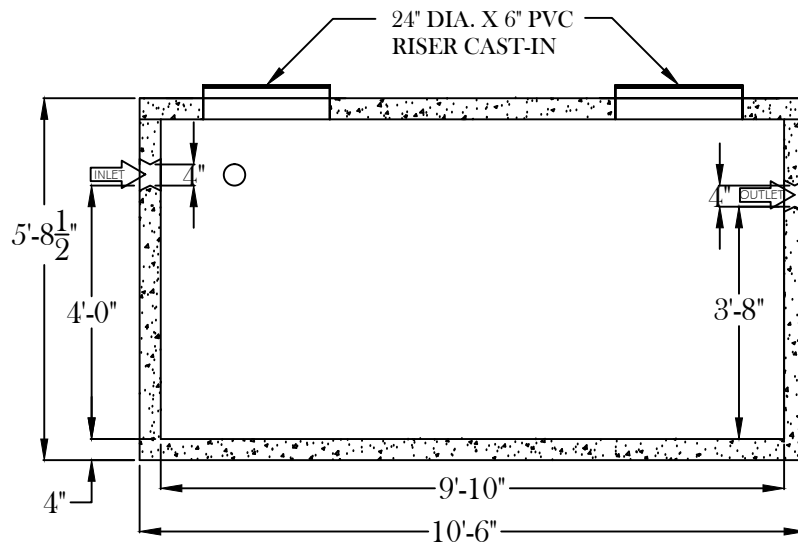

ELEVATION

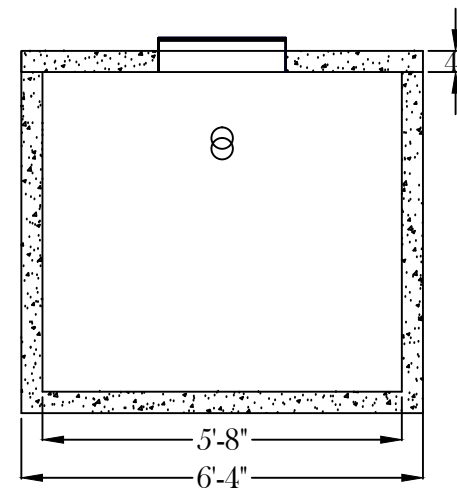

END VIEW

**SPECIFICATION:**

CONCRETE: 4,500 psi concrete (28 days)  
 REINFORCEMENT: Sized and placed per Piperton, Tn design standards.  
 TANK SEALS: ASTM 1227-07a (ASTM C923 tanks seals available)  
 SEALANT: Sealant use for joints meets or exceed C990 Specification



APPROX. WT:  
13,800 lbs.

DRAWN BY:  
Allen Lee

Tank Type: 1,500 Gallon Step Tank



COPYRIGHT 2019  
LEE'S PRECAST